


1" WATER SERVICE FOR 3/4" OR 1" METER W/ RADIO READ

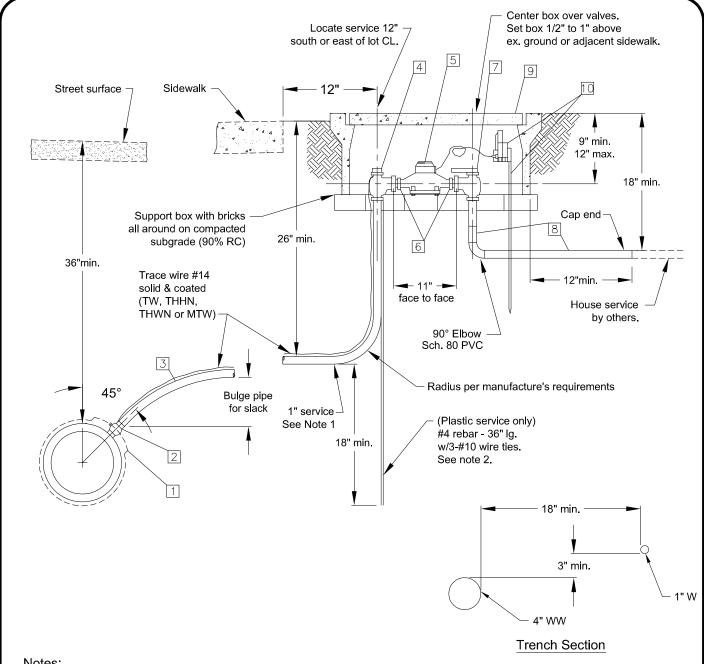

Notes:

- Maintain 24" clearance between tap and any coupling, fitting or adjacent tap. Plastic services shall be looped approximately 6" vertically or laterally to provide slack in the line. If the service is installed in the same trench as the sanitary service, the water service shall be installed without splices and the trench section shown applies.
- 2. Backfill shall conform to Std. Plan 501.
- 3. All fittings shall comply with California No-Lead brass requirements.

Sheet 1 of 3

Γ	Dr.	No.	Date	Revision	Appr.	Approved By:/	STD PLAN
t	Ch.	3	10/05	ADDED METER & ERT		F. Wally Sandelin 4/12/11 F. Wally Sangelin City Engineer Date R.C.E. 39895	
		4	7/09	CHANGED CUSTOMER VALVE			403
	Date	5	3/10	REVISED PER AB 1953 REQ'S.			
		6	4/11	REVISED ERT MOUNTING.			